


G&C Enclosures "HCK" HEATER Spec Sheet

**Heat Cable for Enclosures Housing
Backflow Preventers Sized to 2"**

**UL Listed
CSA Certified
For Use in Damp or Wet Locations**

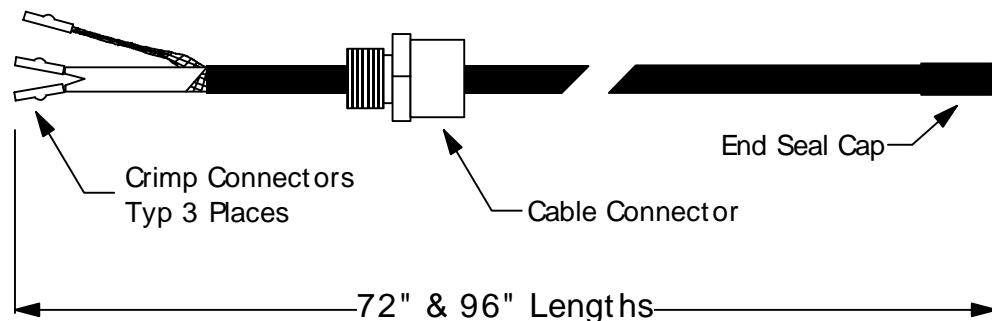

Construction:

Heating Cable: Buss wire is 16 AWG, Nickel-Coated Copper
Tinned Copper Ground Braid Under Outer Jacket
Waterproof Outer Jacket

Cable Connector: Nylon Liquid Tight for installation in NEMA 4 liquid tight junction box furnished by others

End Seal Cap: Heat Shrink, Liquid Tight

Thermostat: Not Required, Self Regulating

Crimp Connectors: Open one end for field connection to power supply

Riser Insulation: Closed Cell Rubber

Nylon Cable Ties: For securing cable to piping and assembly

Standard Ties: For securing insulation to risers

Note: Single run of heating cable. Not wrapped.

